
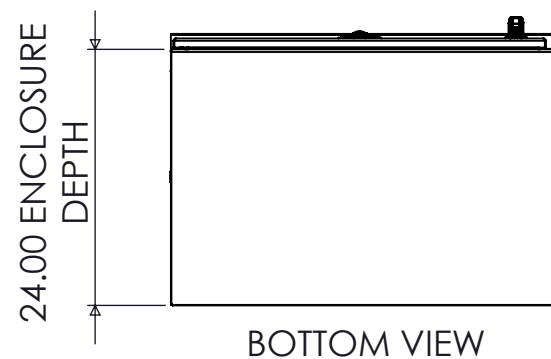
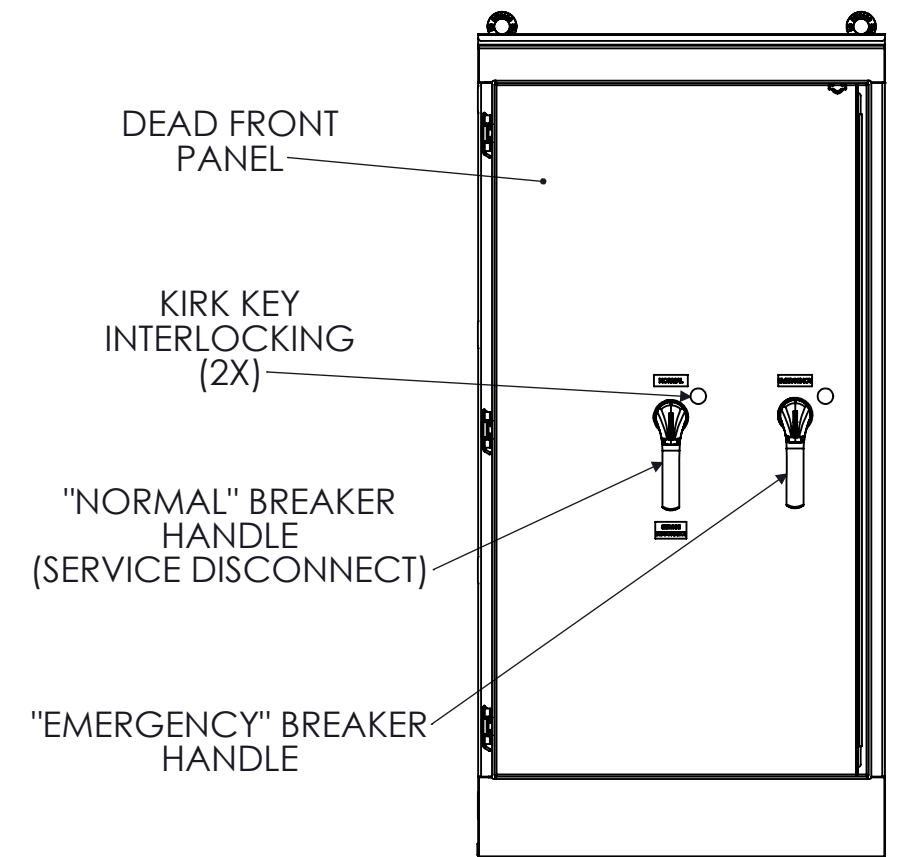
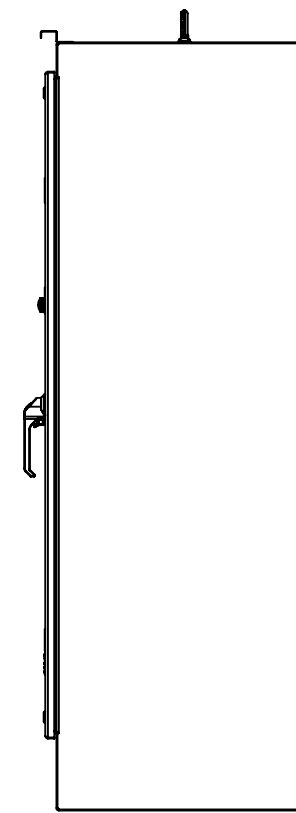
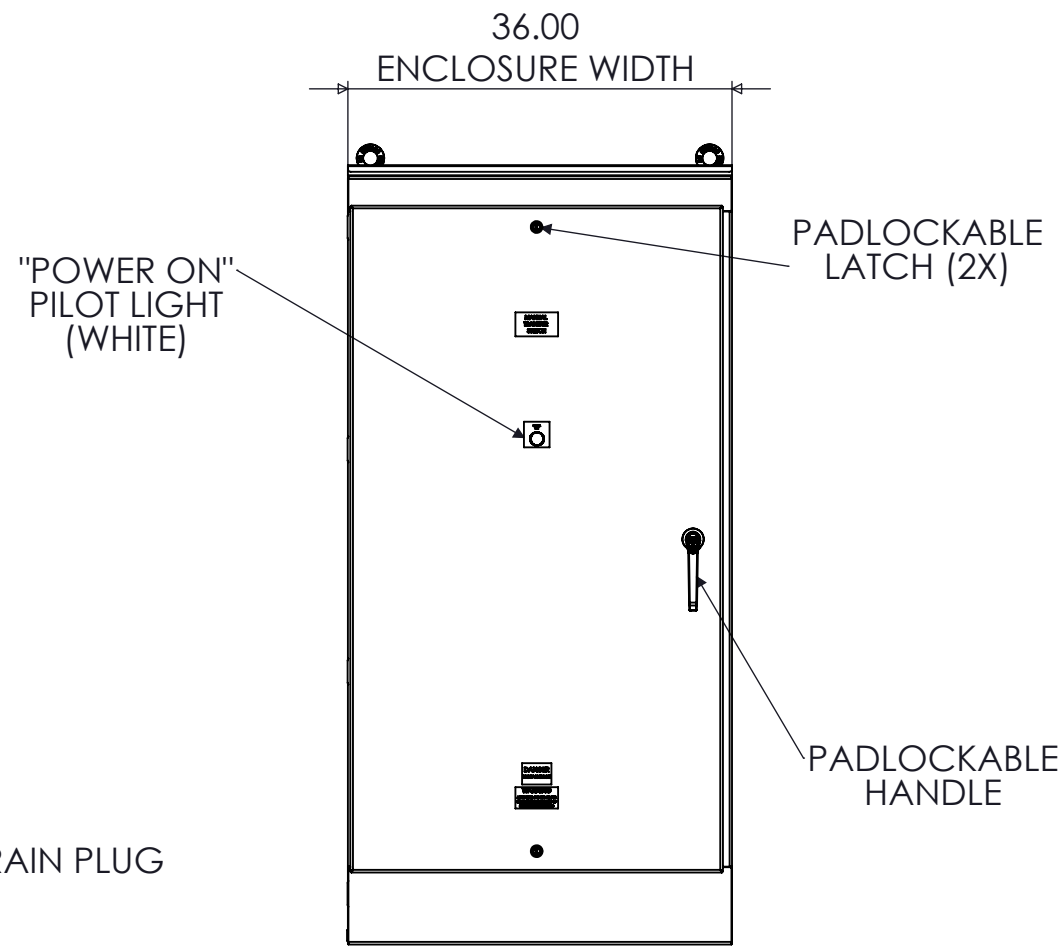
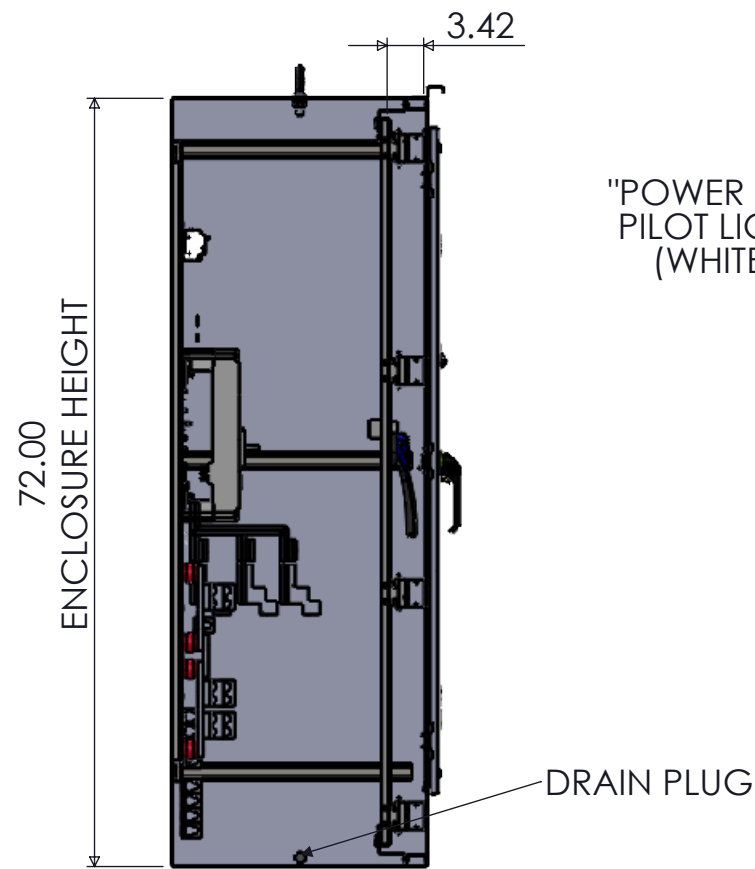


SPECIFICATIONS

MAX VOLTAGE - 600VAC 3 Ø
 RATED CURRENT - 800 A
 STANDARDS - UL508A
 ENCLOSURE RATING - NEMA 3R
 REF. ES11BTS3A
 DURABILITY - 3550 CYCLES
 EST SHIPPING WEIGHT - 425LBS
 COLOR - RAL7035 LIGHT GREY

SPECIAL NOTES:

- 1) IF CAMLOKS ARE MALE, CONNECTION LABELS ARE : L1, L2, L3
- 2) IF CAMLOKS ARE MALE, USE "POWER INLET" LABEL
- 3) IF CAMLOKS ARE FEMALE, CONNECTION LABELS ARE: T1, T2, T3
- 4) IF CAMLOKS ARE FEMALE, USE "POWER OUTLET" LABEL
- 5) BREAKERS ARE KIRK KEY INTERLOCKED. ONLY ONE CAN BE ENERGIZED AT A TIME.
- 6) FRAME 5 MUST BE UTILIZED FOR THE BREAKERS TO ACCOMDATE THE HARD BUS.

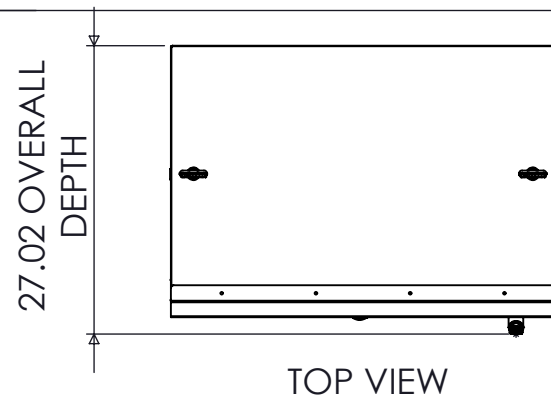


RECEPTACLE/COVER COLOR SCHEME


	L1	L2	L3	N	GND
240VAC	BLK	RED	BLU	WHT	GRN
480VAC	BRN	ORG	YEL	WHT	GRN
600VAC	BLK	BLK	BLK	WHT	GRN

800A NEMA 3R BREAKER-BREAKER TRANSFER SWITCH					
REV	DESCRIPTION	DATE	DRAWN C. JUNG		
0	ORIGINAL RELEASE	1/17/17	CHECKED		
1	BUSSING ADDED	3/14/22	SUP. NO	DRAWING TYPE	
			SUP. BY NO	DIMENSIONAL	
			PANEL NO	DRAWING NUMBER	
			BUL. NO	BTS800N3RSE3A	
			GROUP NO		
			ORDER NO		


PSI
 Power & Controls
 9900 TWIN LAKES PARKWAY
 CHARLOTTE, NC 28269
 704-596-5617
 PSICONTROLSOLUTIONS.COM

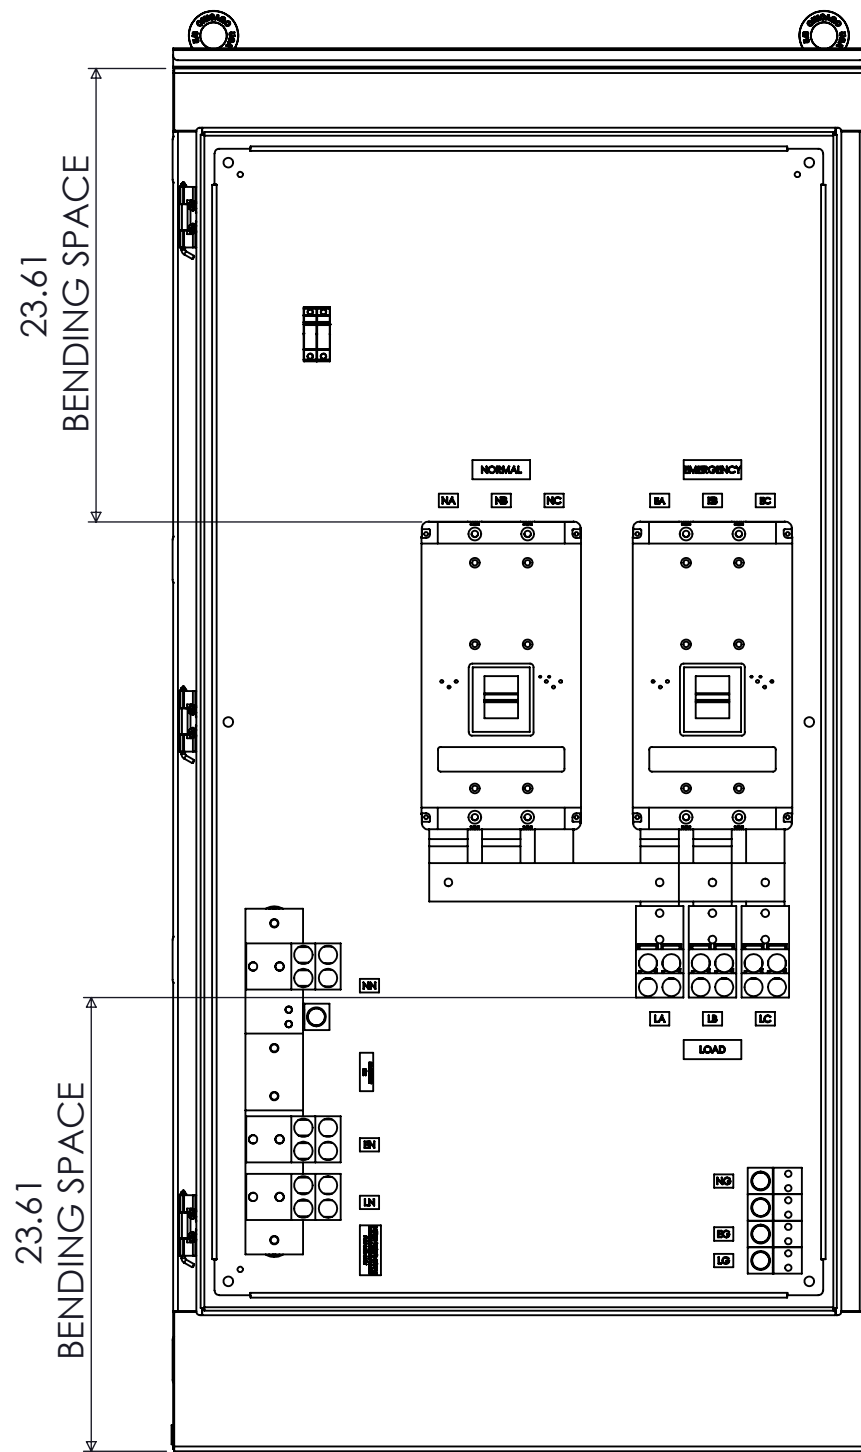

FRONT VIEW
DOOR REMOVED

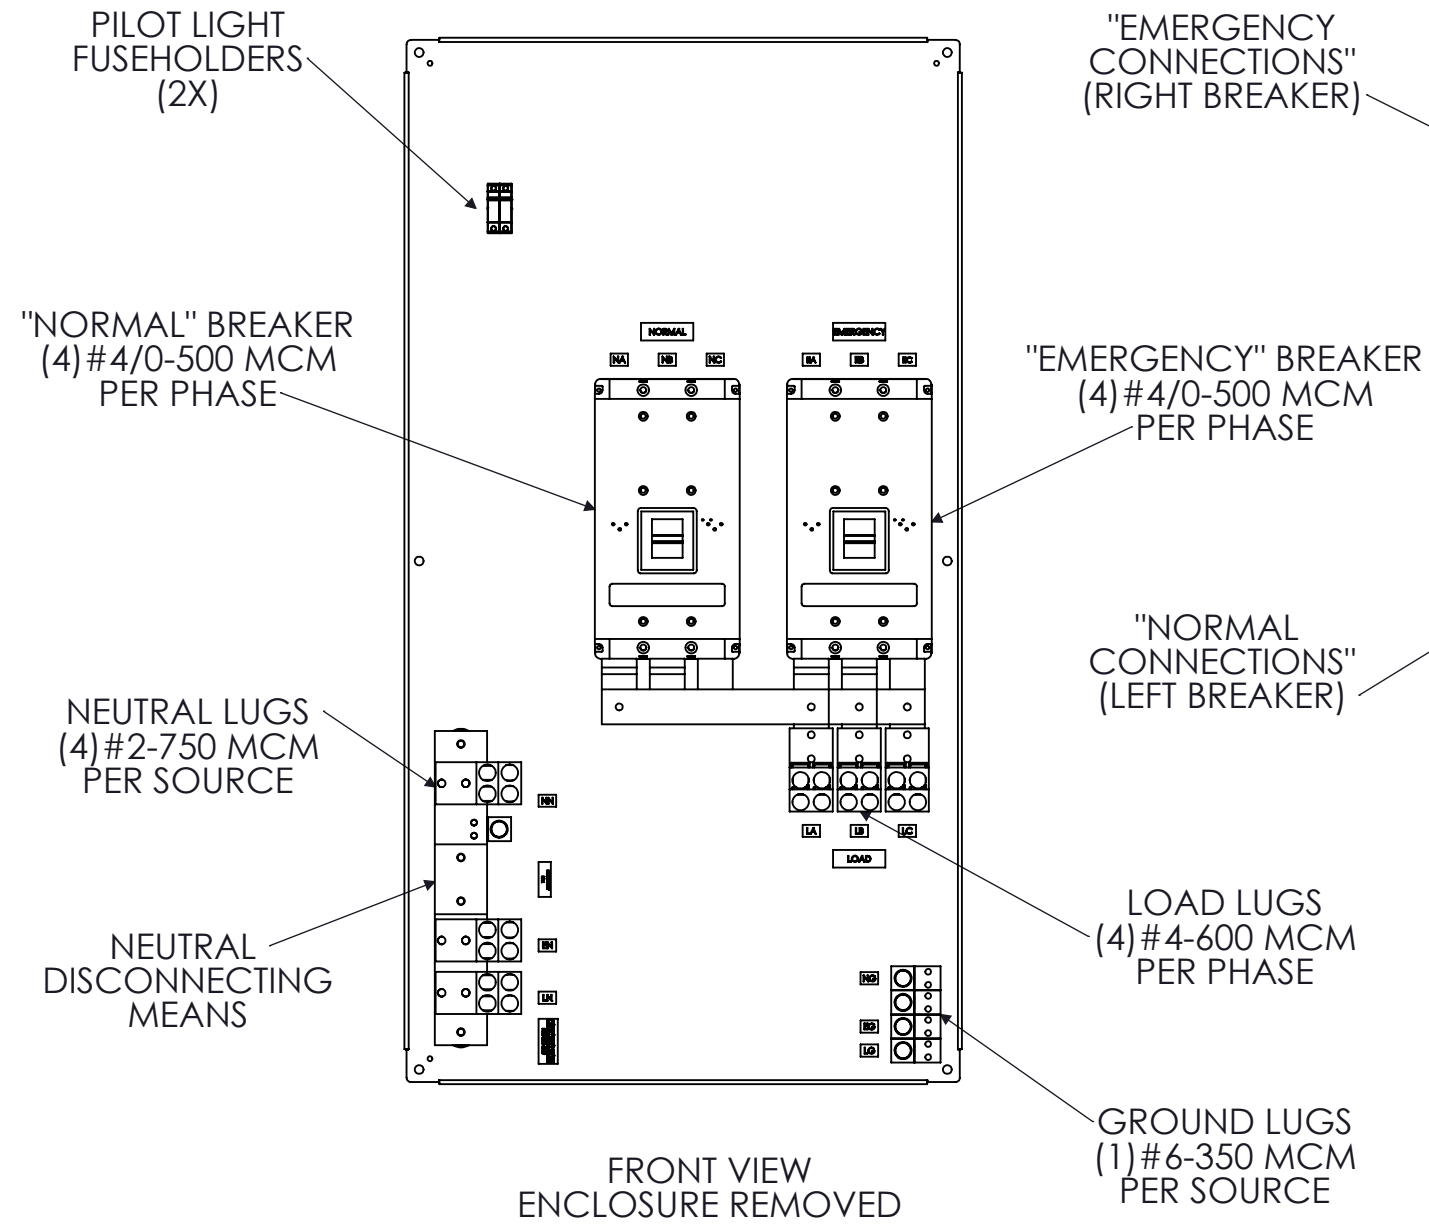

FRONT VIEW
ENCLOSURE REMOVED

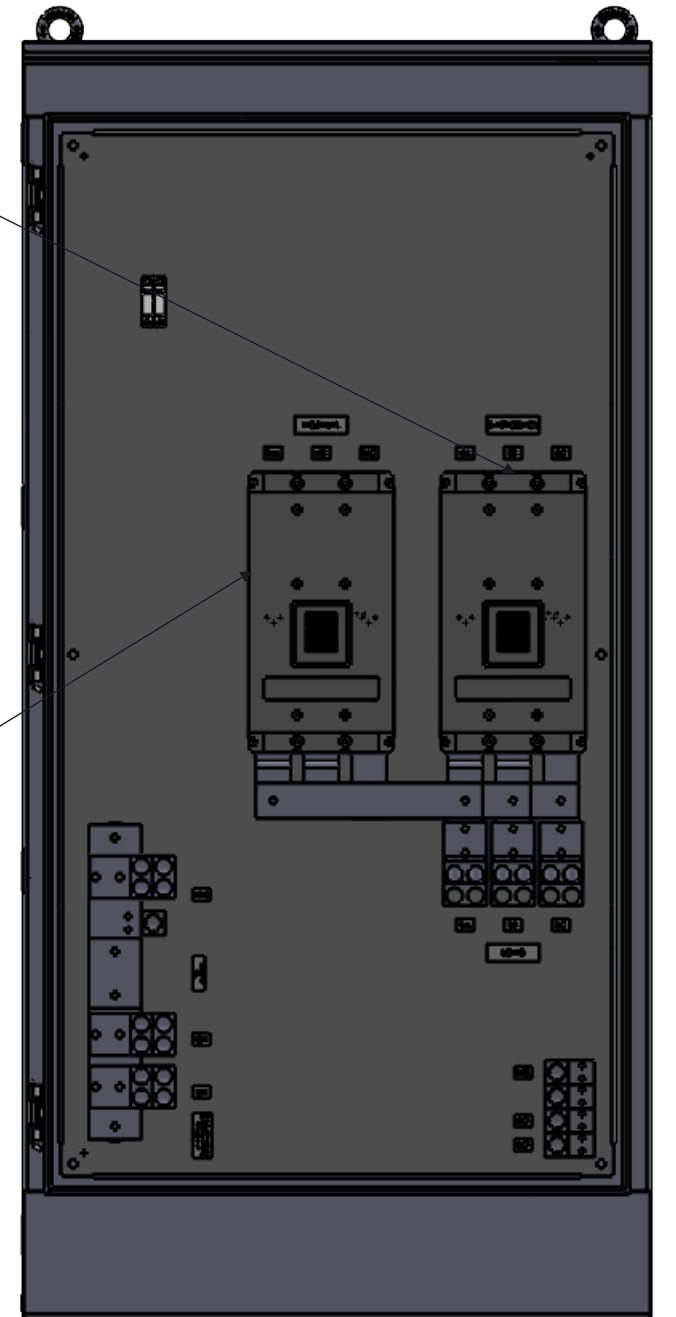

FRONT VIEW
DOOR REMOVED

800A NEMA 3R BREAKER-BREAKER TRANSFER SWITCH

REV	DESCRIPTION	DATE	DRAWN	C. JUNG
0	ORIGINAL RELEASE	1/17/17	CHECKED	
1	BUSSING ADDED	3/14/22	SUP. NO	
			SUP. BY NO	
			PANEL NO	
			BUL. NO	
			GROUP NO	
			ORDER NO	

DRAWING TYPE
OUTLINE

DRAWING NUMBER
BTS800N3RSE3A

PSI Power & Controls
 9900 TWIN LAKES PARKWAY
 CHARLOTTE, NC 28269
 704-596-5617
 PSICONTROLSOLUTIONS.COM