
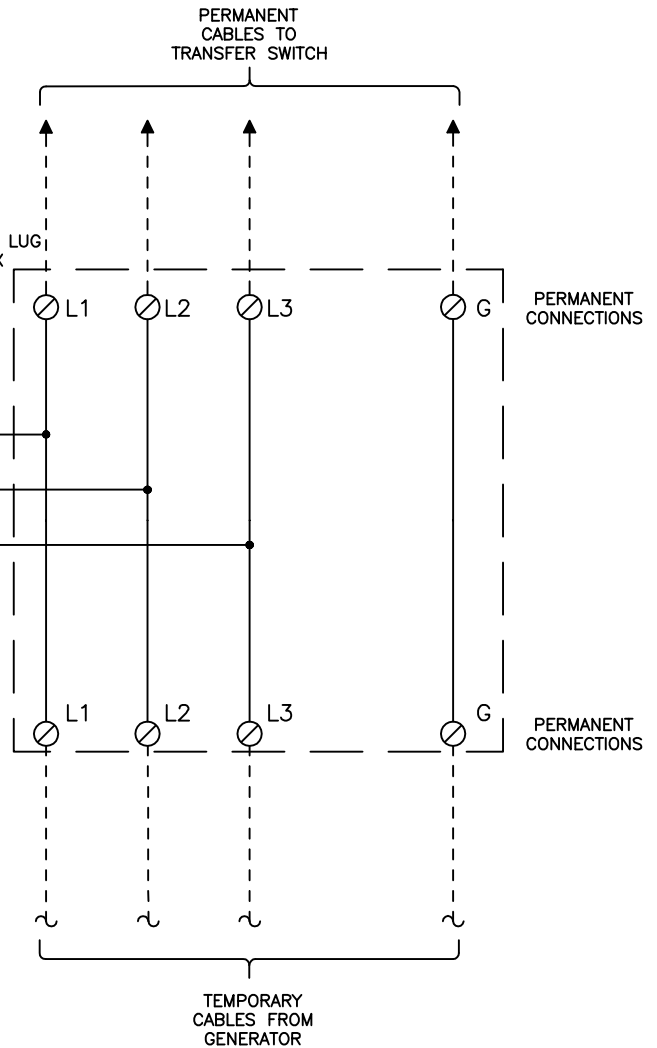
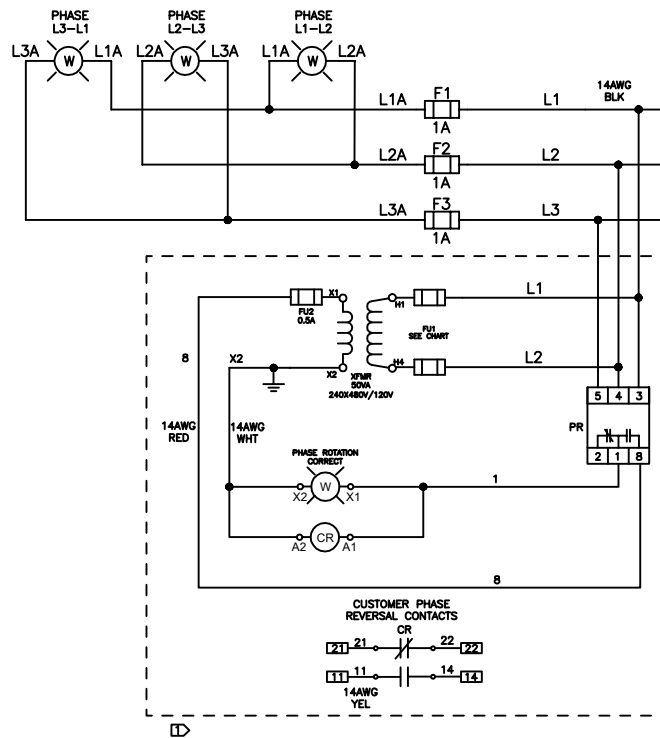
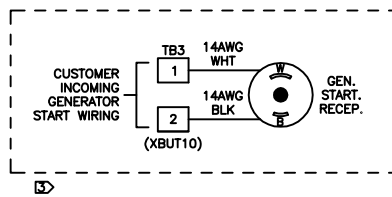


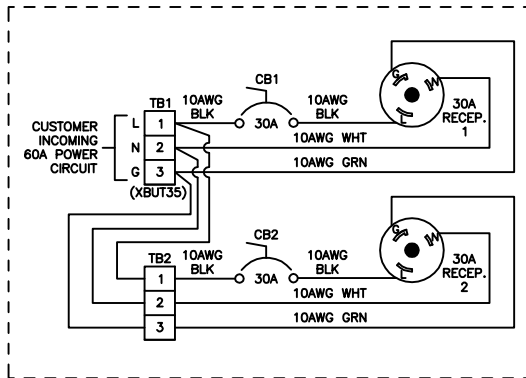

- NOTES
- ① PHASE REVERSAL PROTECTION OPTION
 - ② 30A BLOCK HEATER RECEPTACLE OPTION
 - ③ GENERATOR 2-WIRE START RECEPTACLE OPTION

FUSE SIZING FU1

VAC	A
208/240	0.6A
480	0.3A

LUG TO LUG BOX

REV	DESCRIPTION	DATE	DRAWN D. DENNY	ENGR. APP.
A	ORIGINAL RELEASE	4/20/16	CHECKED	SUPR. APP.
B	OPTIONS ADDED	4/24/20	SUP. NO.	
C			SUP. BY NO.	
D			PANEL NO.	
E			BUL. NO.	
F			GROUP NO.	
G			ORDER NO.	

ES11L2L4

COMPUTER GENERATED TRACING



PSI CONTROL SOLUTIONS

9900 TWIN LAKES PARKWAY
CHARLOTTE, NC 28269
704-596-5617
PSICONROLSOLUTIONS.COM